




**LPF Gap, CA**

2 July 2008, T1 A

Major Values-at-Risk per  
FSPRO Fire Spread Probabilities:  
7 days as of 2 July 2008

- FSPRO Fire Perimeter 2 July am
- Past Fires 1994-2007
- 2007 Fires
- FSPRO Fire Spread 7 days from 2 July**
- > 80 %
- 60 - 80 %
- 40 - 60 %
- 20 - 40 %
- 5 - 20 %
- 1 - 5 %
- < 1 %
- Building Clusters Santa Barbara Co.
- RAWs Stations
- Water: Dams > 100af
- Water Supply: Intakes
- Water Treatment Plants
- Water Pipeline - Aqueduct - Canal
- Powerlines
- Industrial Plant
- Power Pylon
- Power or Pumping Substation
- Communication Towers
- Oil & Gas Transmission Lines
- Airports
- Airport Runways
- Ski Resort Cables
- Hospitals
- Schools
- HAZMAT: Mines
- HAZMAT: Superfund Sites
- HAZMAT: Hazardous Waste
- HAZMAT: Landfill
- Other Landmarks
- Interstates
- Major Roads
- Local Roads (USFS)
- Railways
- County Boundary
- Jurisdiction**
- Private
- State
- BLM
- BOR
- USFS
- Inventoried Roadless
- Designated Wilderness
- Experimental RNA
- Wild-Scenic-Rec Rivers

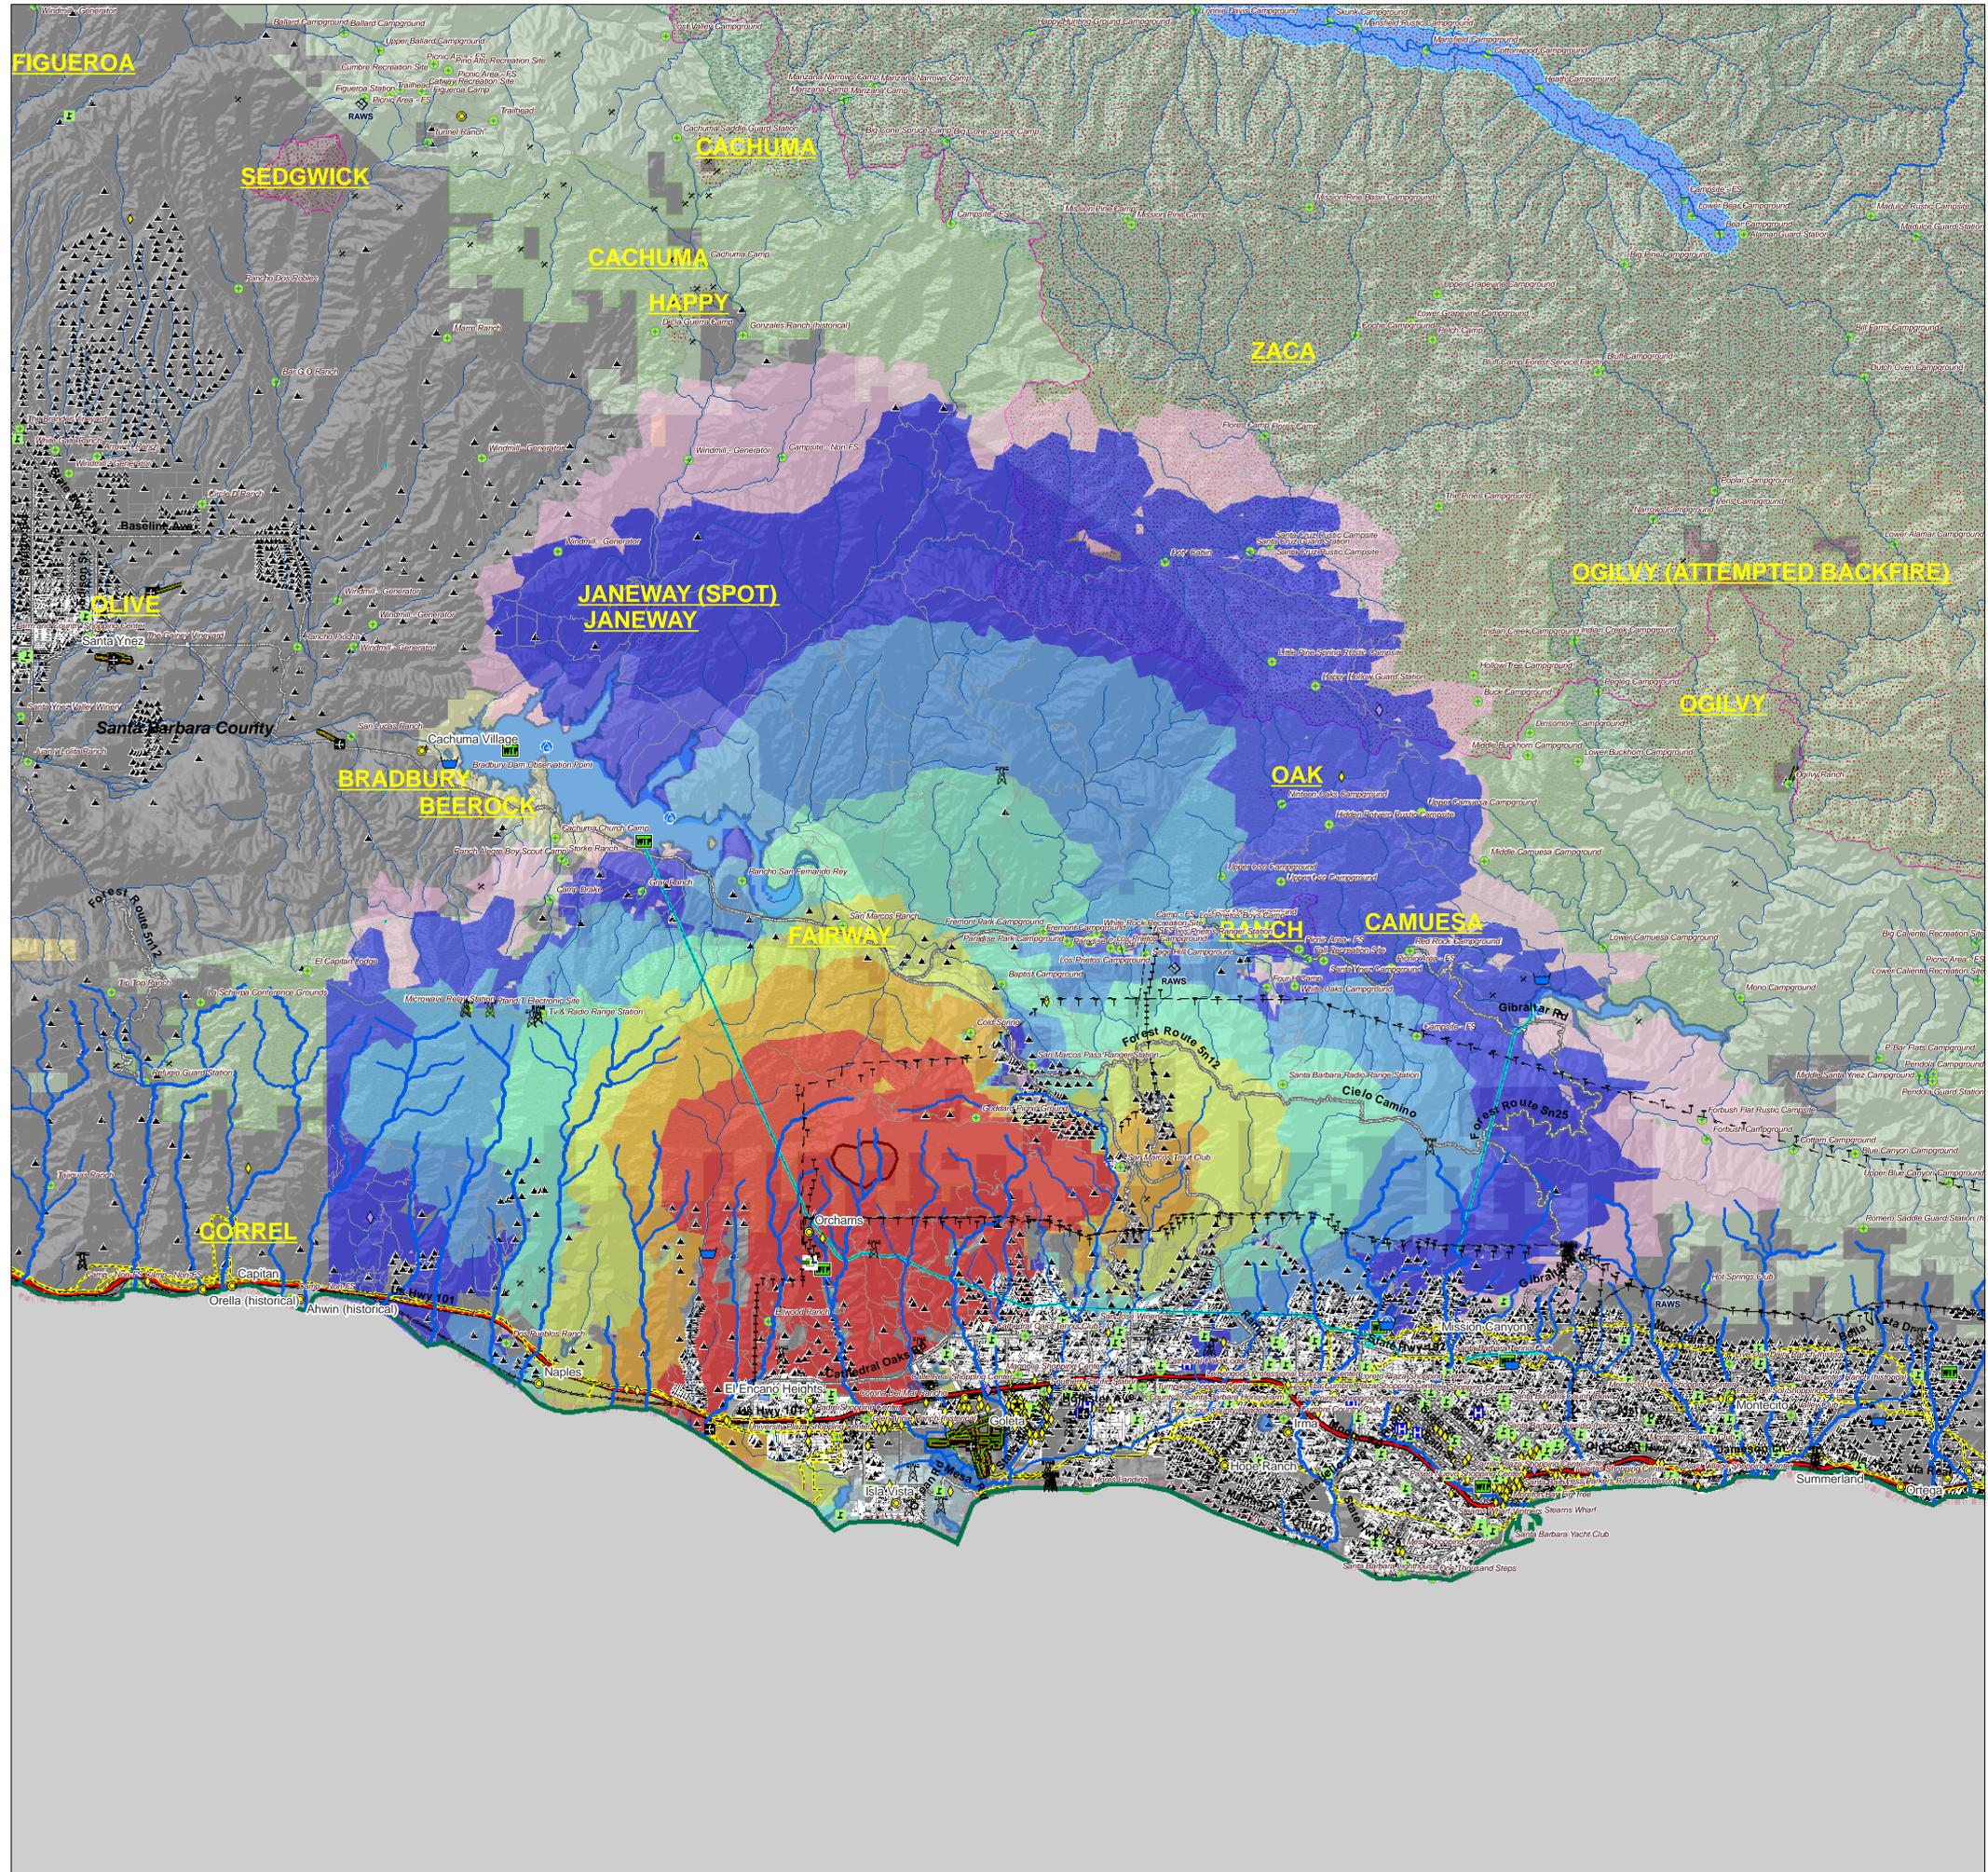

Building Clusters represent the center of parcels where county assessor records indicate taxable improvements are present. One or more structures and other improvements may exist proximate to these point locations.

CAUTION: Defer to air photos or local knowledge for exact structure and other feature locations.

Recreation residences and special use structures data are not available from USFS and are not identified or analyzed in this report.

1:60,000

